

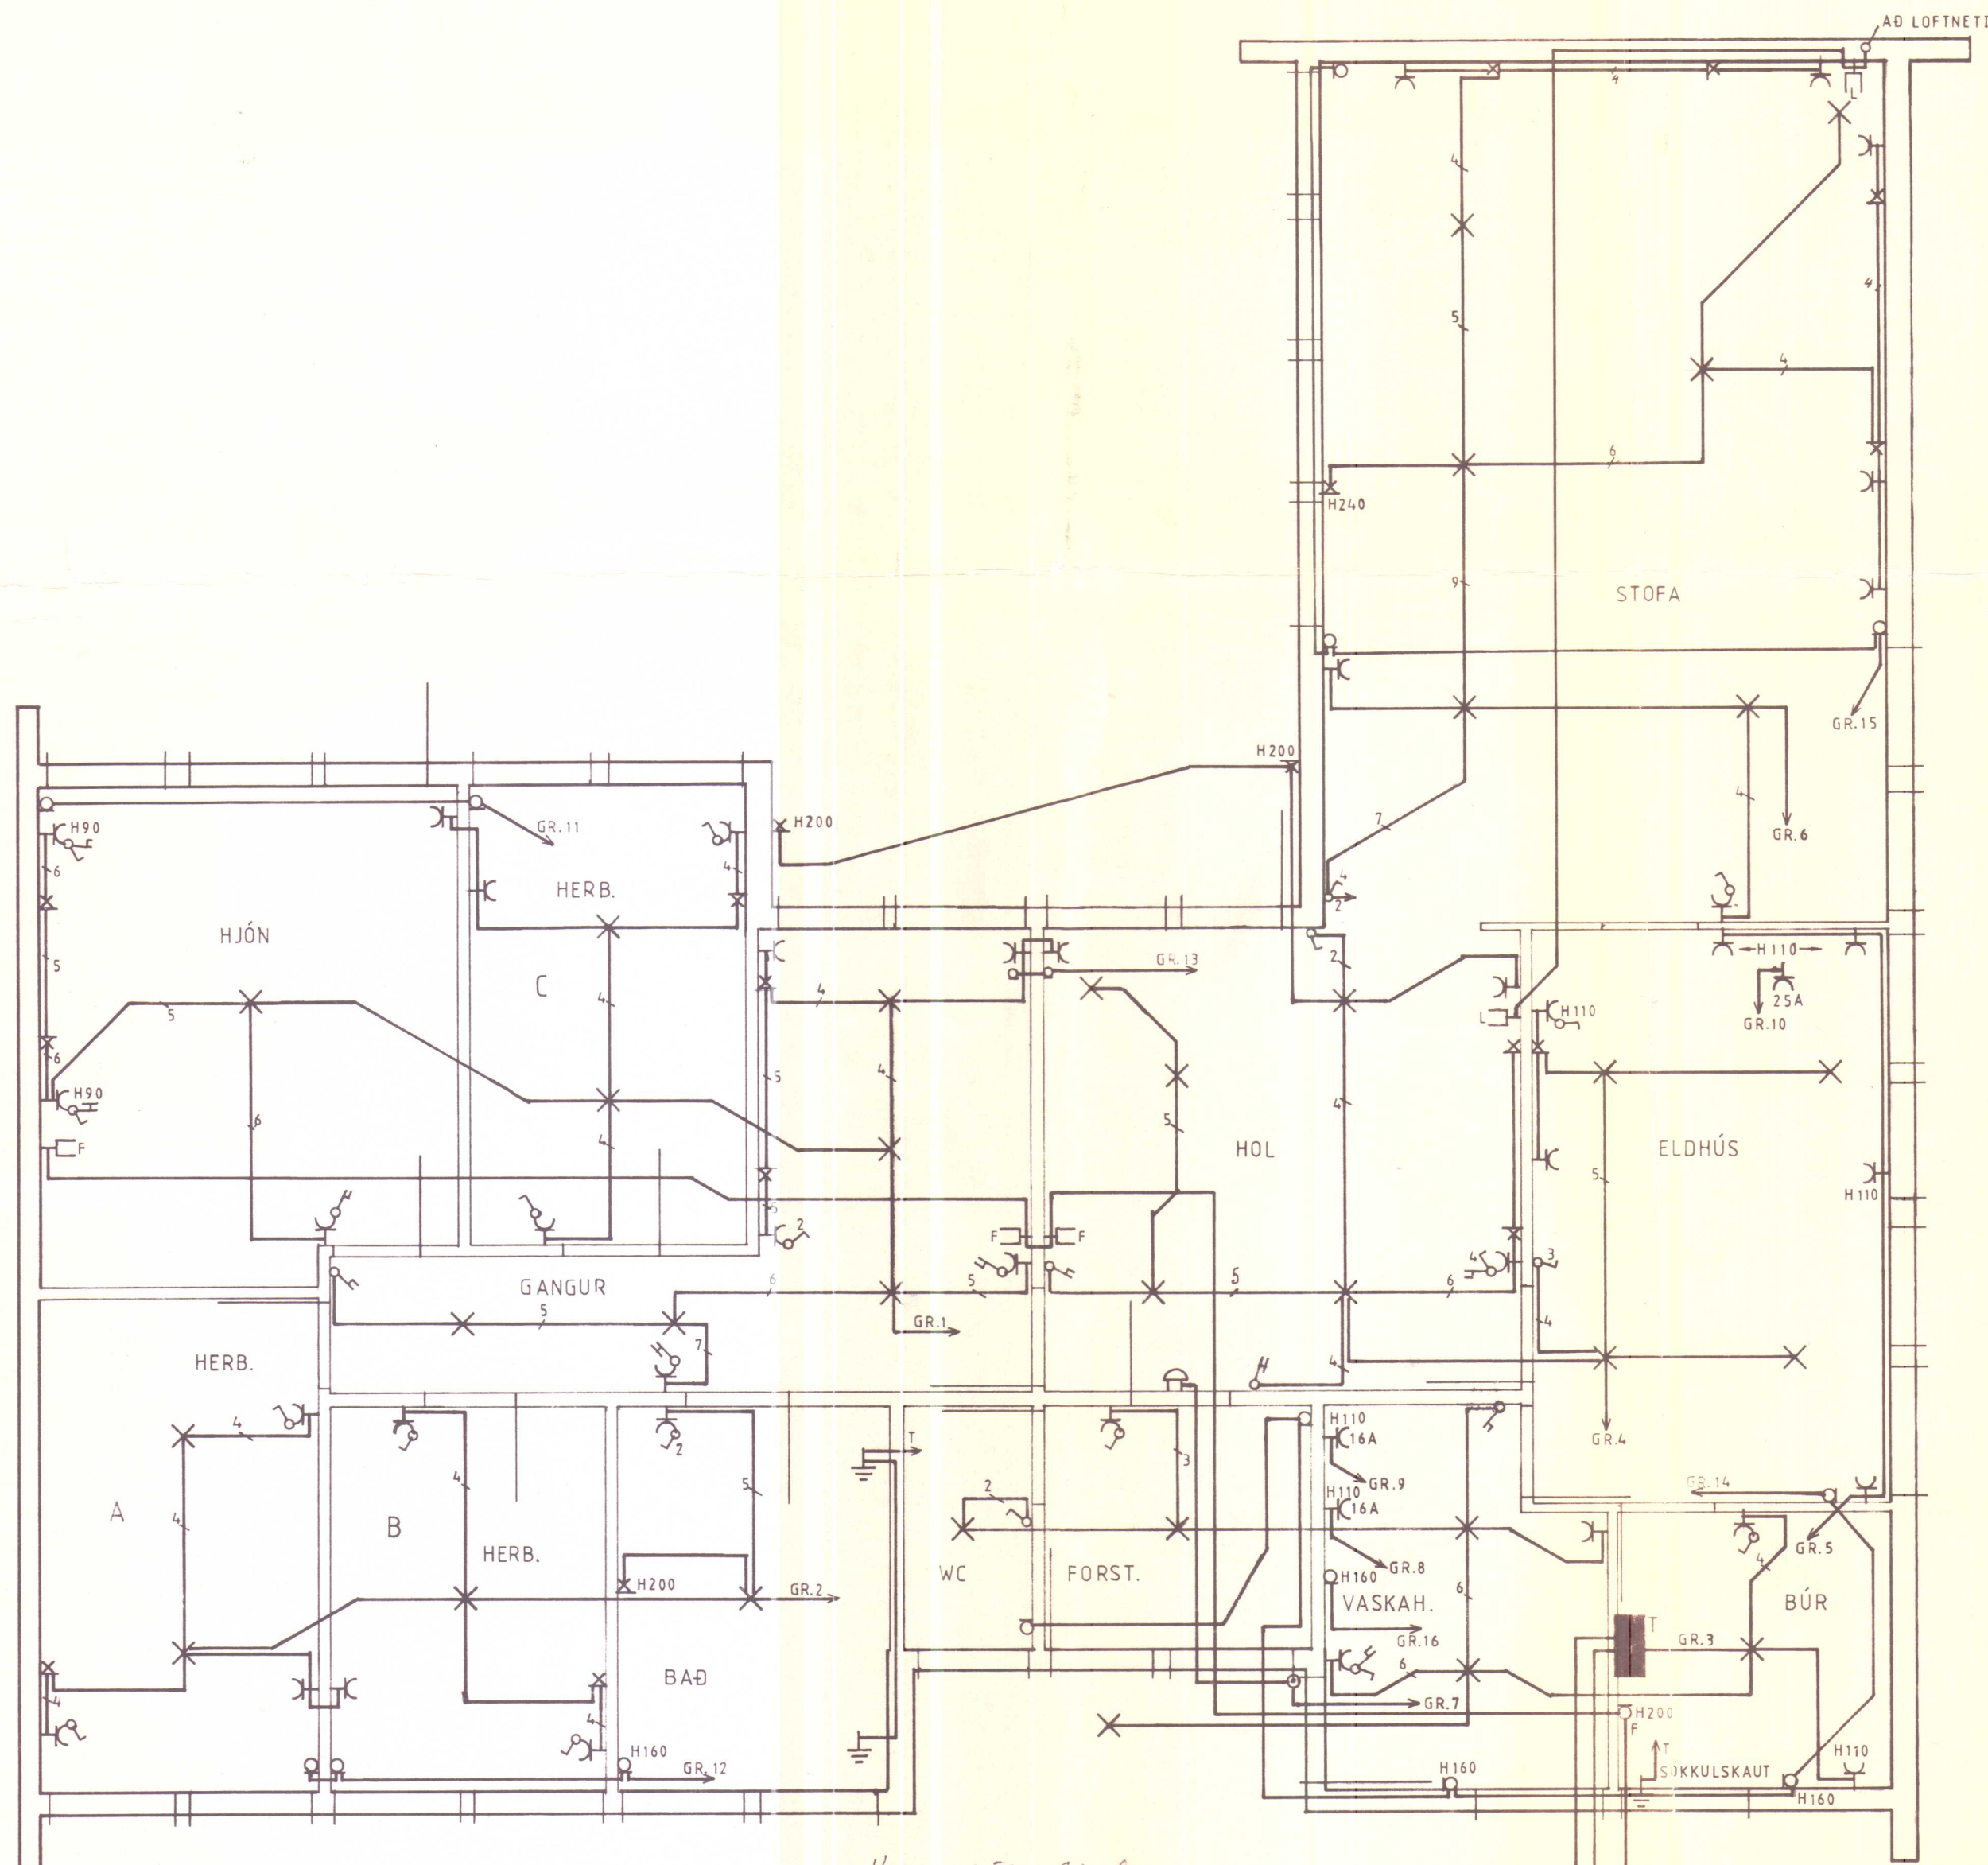


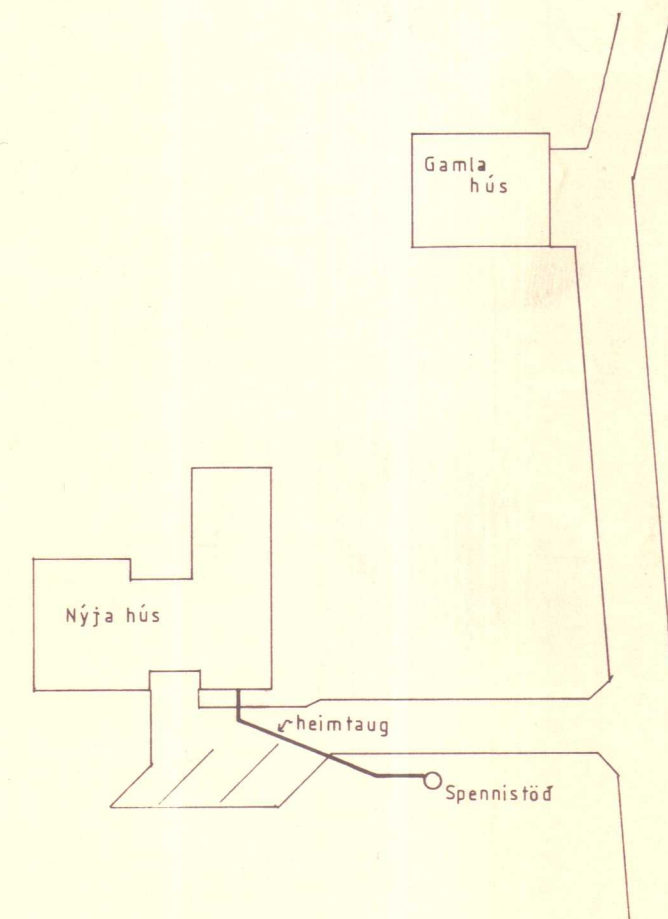

Hús skúla Sigfússonar
 Gröf Þorkelshólshreppi
 ágúst 1885
 Magnús B. Halldórsson.

SIMI Ø 25
 RARIK Ø 50
 ÚTIHÚS Ø 50

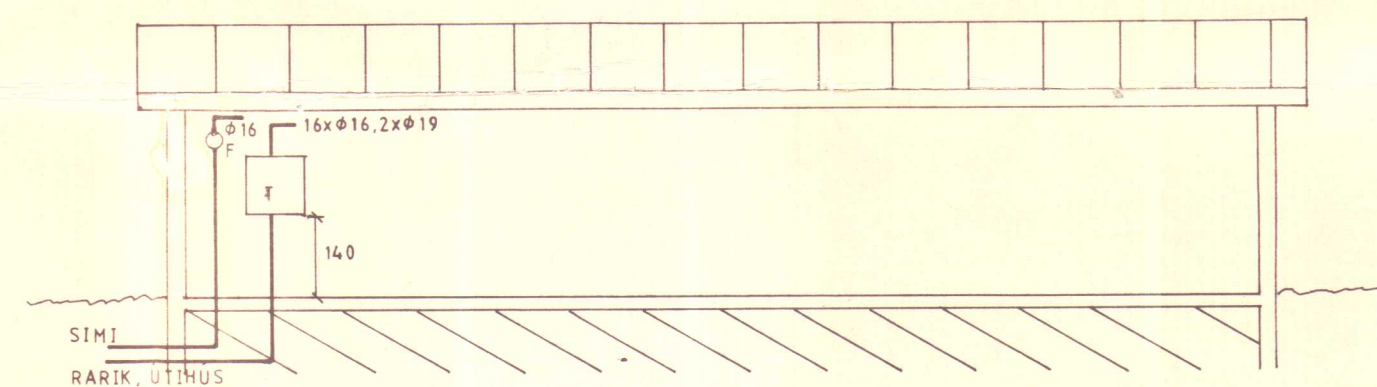


Rafn
 Hafsteinn Pétursson

1233

ORNLISTI:		
staður:	stærð w:	stærð m:
hjá	1000	400x1100
herb. A	750	400x 800
herb. B	450	400x 500
herb. C	750	400x 800
bað	450	400x 500
gangur	1000	400x1100
vs	200	400x 300
forst.	200	400x 300
vaskahús	450	400x 500
eldhús	1000	400x1100
hol	1350	400x1400
stofa	600	400x1100
stofa	600	400x1100
stofa	1350	400x1400

Skýringar.
Hæð rofa skal vera 110cm frá fullfr. gólfi
Hæð tengla skal vera 20cm frá fall fr. gólfi.
Far sem rofar og tenglar eru sanna skal hæðin
vera 110cm. Hæð ofnategidhúsa skal vera 20cm
frá fullfr. gólfi.
Málstraumur rofa og tengla skal vera 10 A.

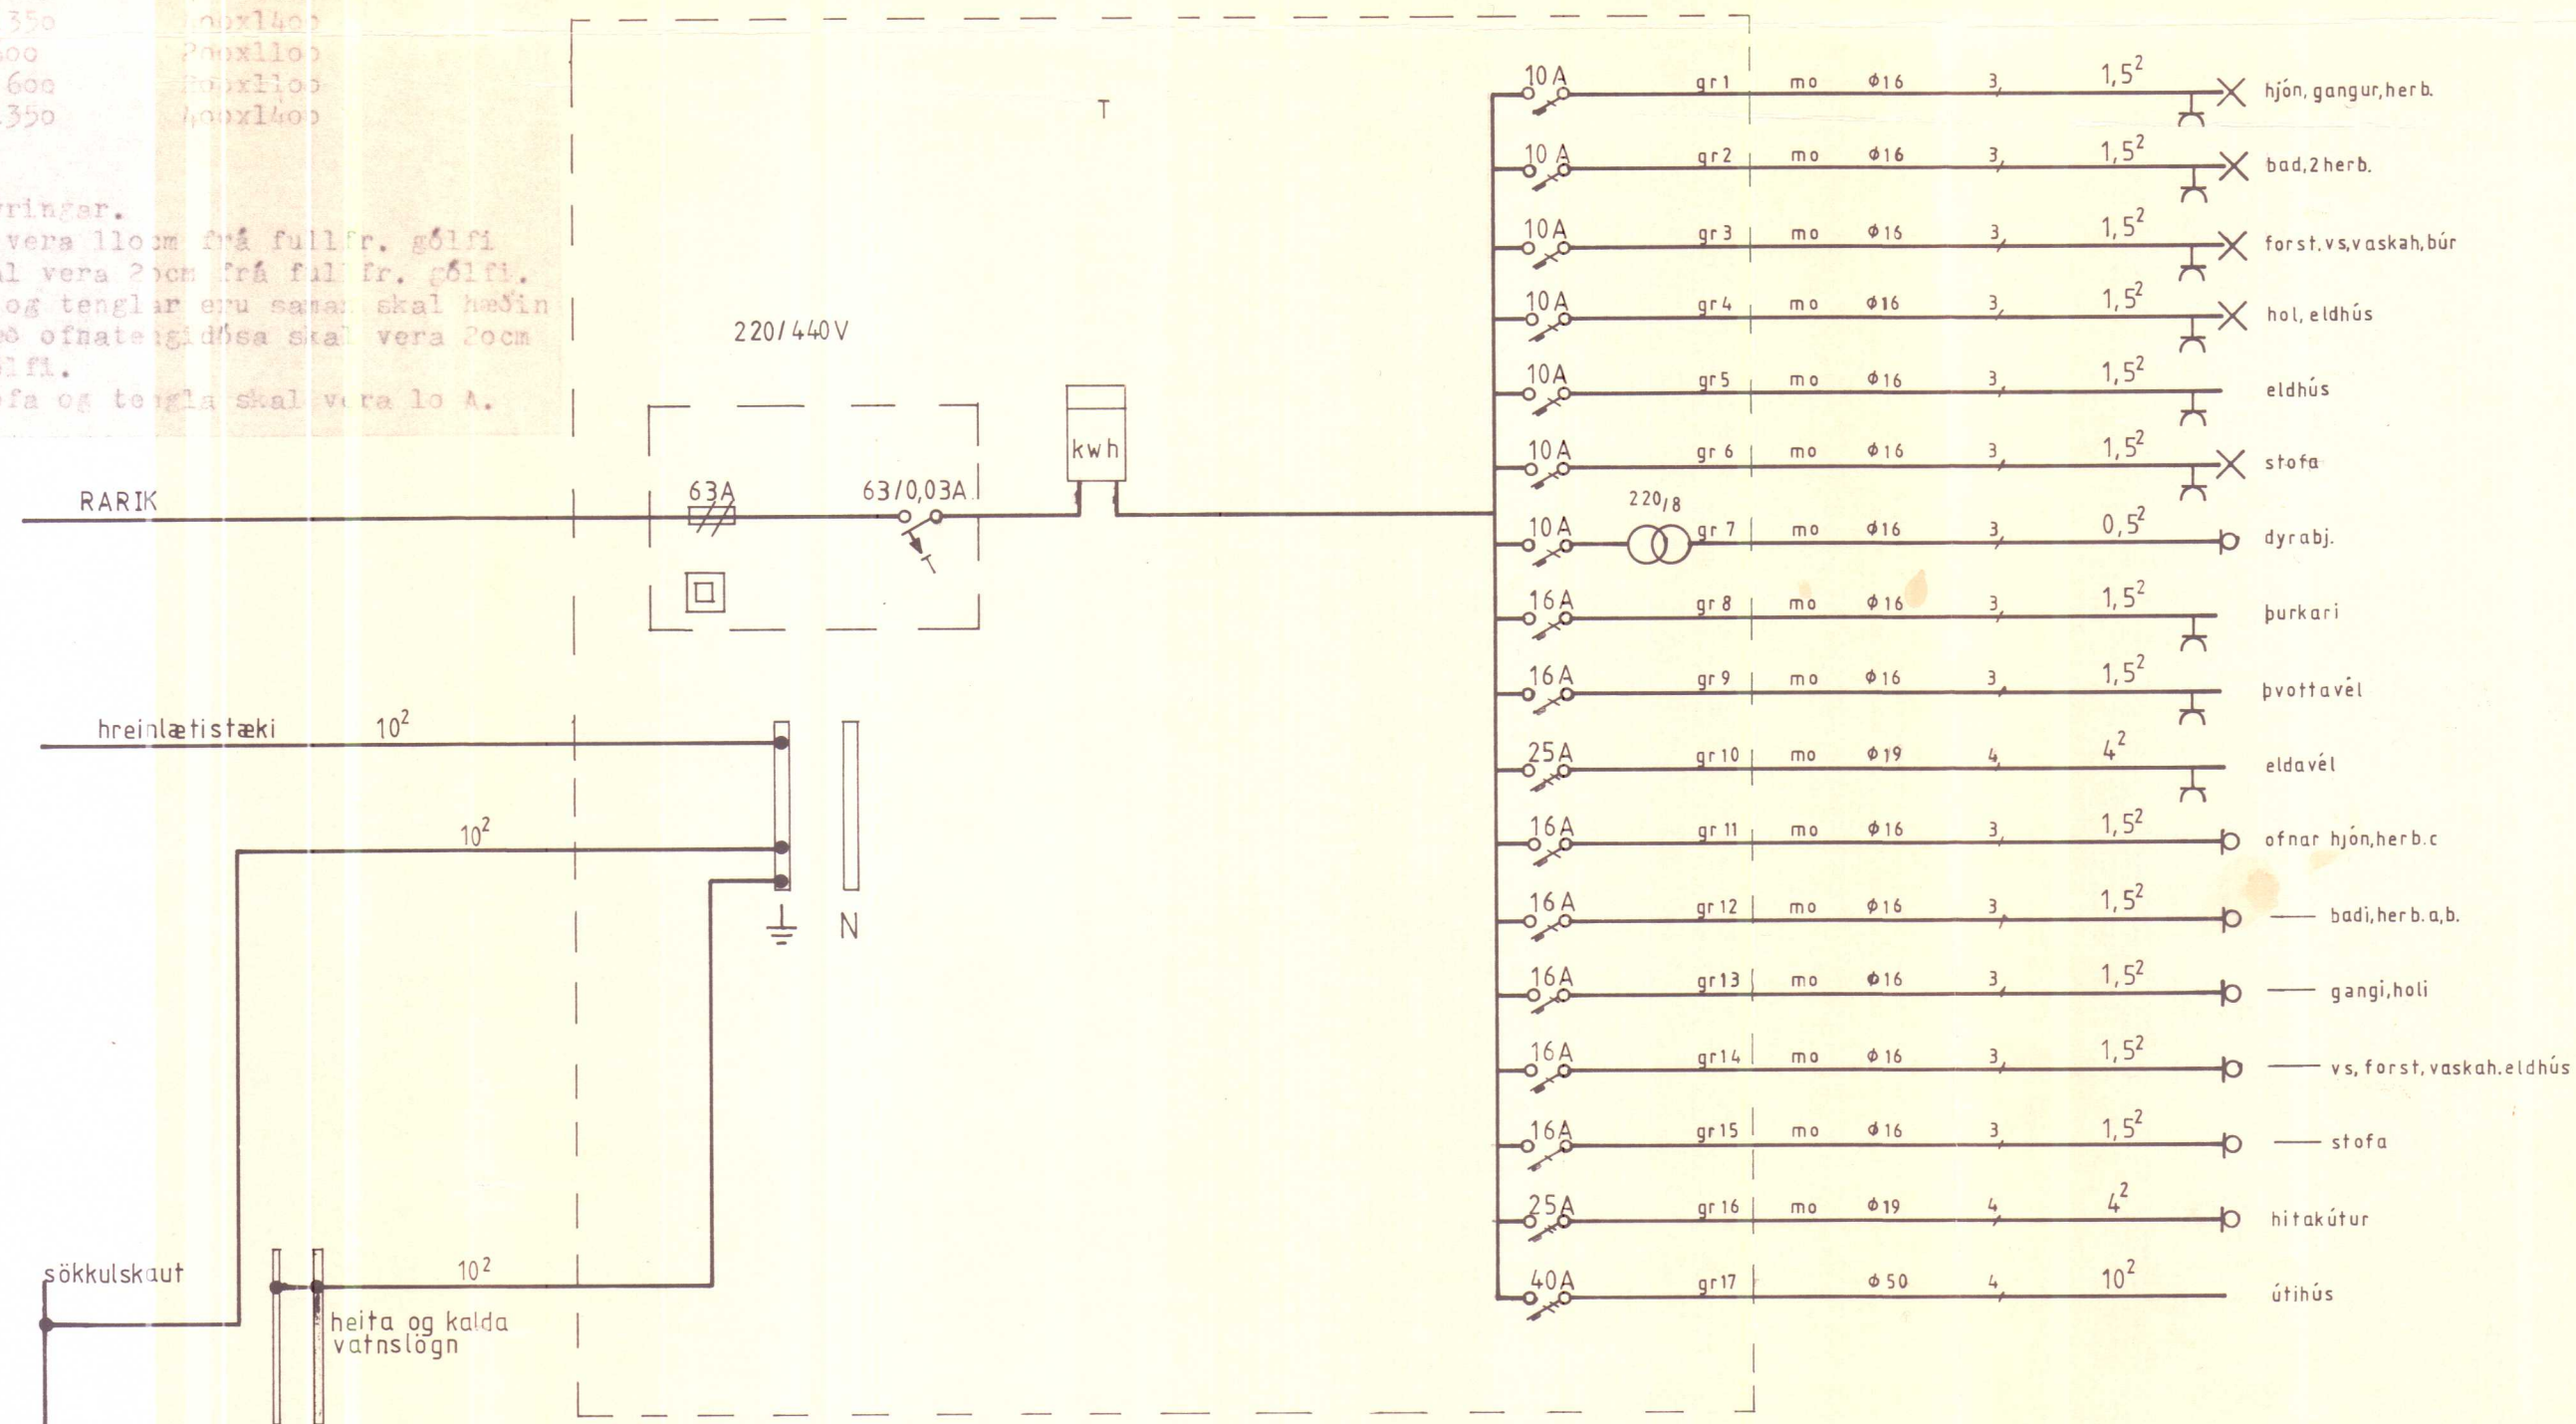

Hús Skúla Siglissunar
Gröf Þorkels Møls hreppi
ágr. 1985
Magnús B. Halldórsson